



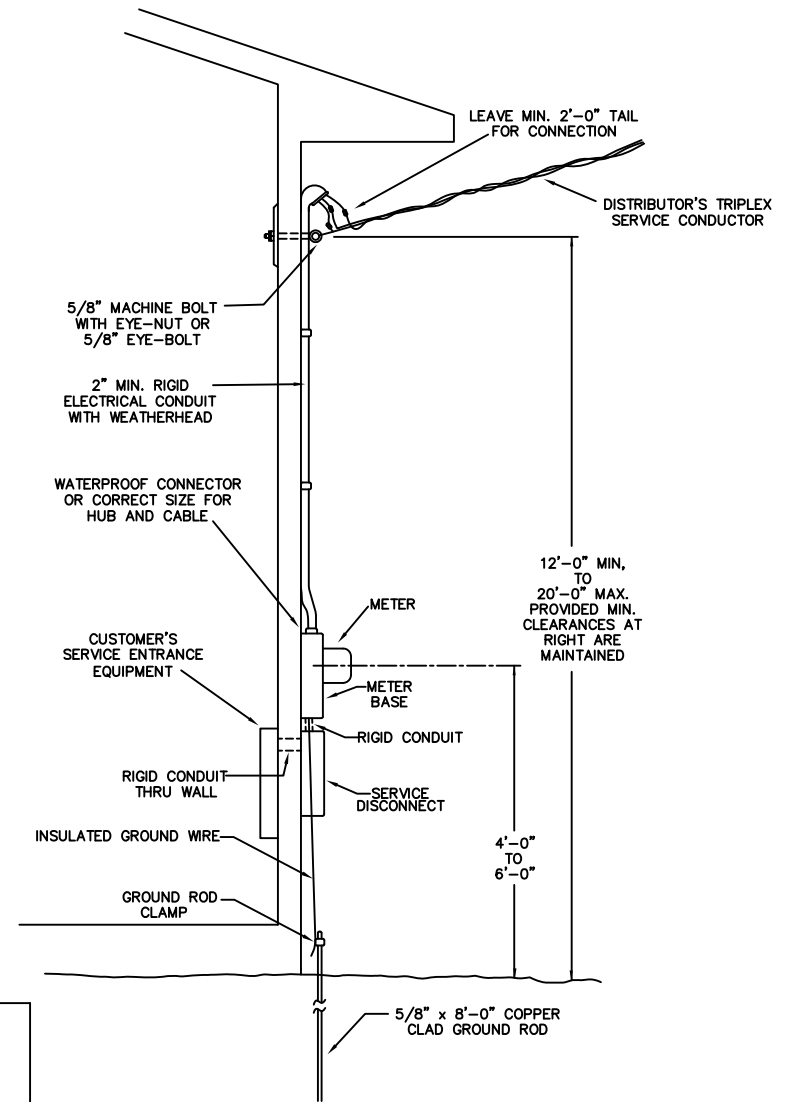
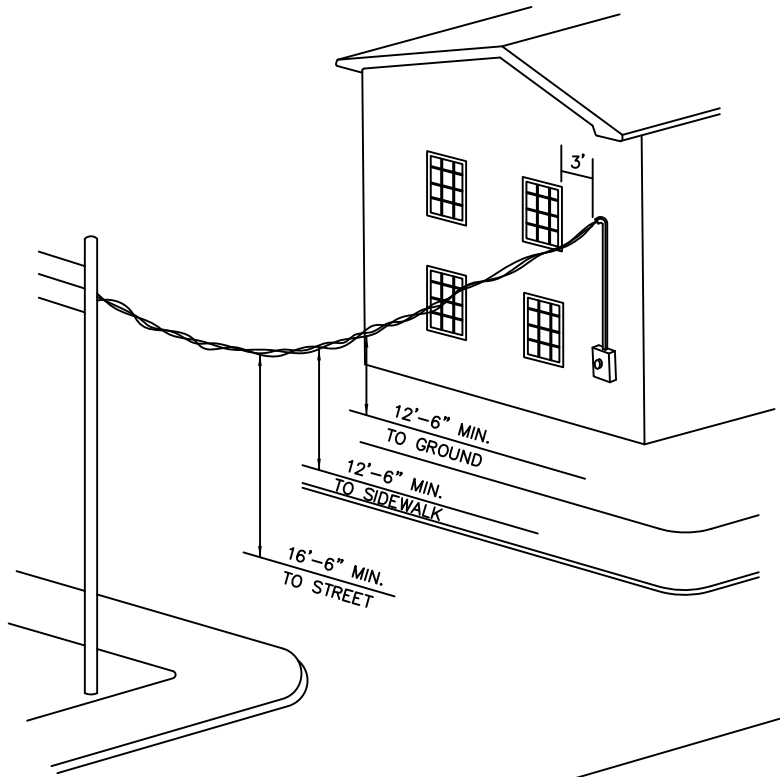
RESIDENTIAL SINGLE PHASE ONLY (MINIMUM SPECIFICATIONS)

SERVICE SIZE	COPPER WIRE SIZE		ALUMINUM WIRE SIZE		CONDUIT SIZE
	PHASE CONDUCTORS TYPE THW	INSULATED NEUTRAL ONLY	PHASE CONDUCTORS TYPE THW	INSULATED NEUTRAL ONLY	
200	2/0	#2	4/0	2/0	2 1/2"
400	PARALLEL 2/0	PARALLEL #2	PARALLEL 4/0	PARALLEL 2/0	(2) 2 1/2"

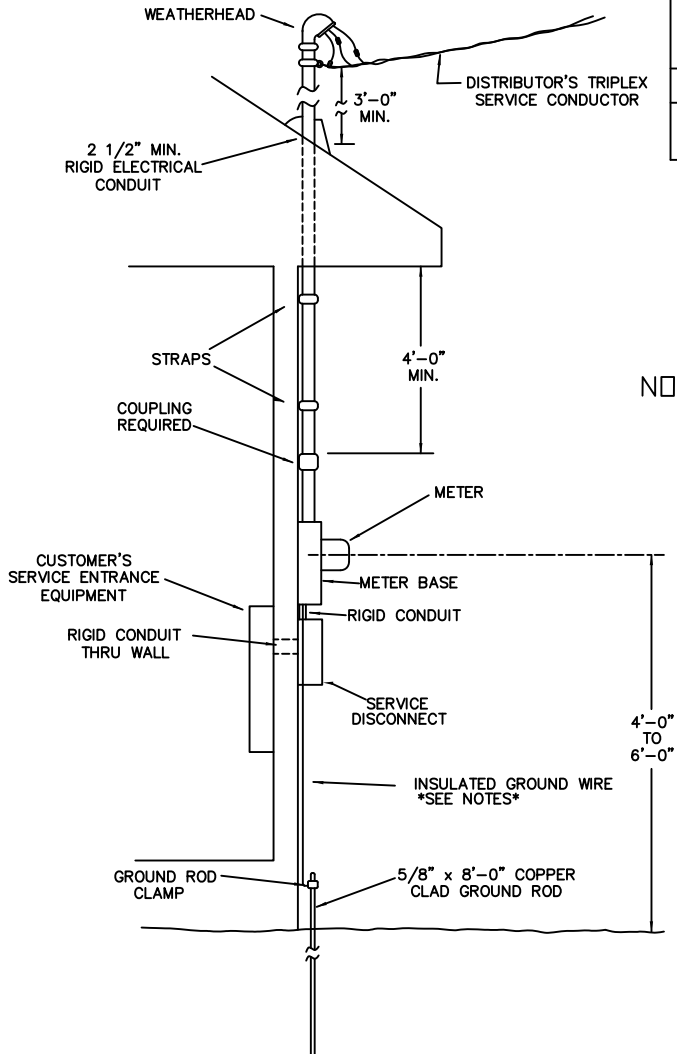

- NOTES:
1. THE NEUTRAL SHALL BE INSULATED.
 2. GROUNDING CONDUCTOR FOR ALL 200 AMP SERVICES SHALL BE INSULATED #4 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.
 3. GROUNDING CONDUCTOR FOR ALL 400 AMP SERVICES SHALL BE INSULATED 1/0 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.
 4. F.E.D. RECOMMENDS THAT CUSTOMER COMPLY WITH NATIONAL ELECTRICAL CODE (LATEST EDITION) WITH REGARD TO WIRING

		FLORENCIA UTILITIES ELECTRICITY														
		SCALE	APPROVED BY	DRAWN BY T. PIGG												
DATE 01/06/22		OVERHEAD SERVICE FOR HOUSE (SERVICE THROUGH ROOF)														
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2" style="text-align: center;">REVISED</th> </tr> <tr> <th style="text-align: center;">DATE</th> <th style="text-align: center;">INITIALS</th> </tr> </thead> <tbody> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> </tbody> </table>		REVISED		DATE	INITIALS									w.o.#	DRAWING NUMBER S-6096	
REVISED																
DATE	INITIALS															



RESIDENTIAL SINGLE PHASE ONLY (MINIMUM SPECIFICATIONS)

SERVICE SIZE	COPPER WIRE SIZE		ALUMINUM WIRE SIZE		CONDUIT SIZE
	PHASE CONDUCTORS TYPE THW	INSULATED NEUTRAL ONLY	PHASE CONDUCTORS TYPE THW	INSULATED NEUTRAL ONLY	
200	2/0	#2	4/0	2/0	2"
400	PARALLEL 2/0	PARALLEL #2	PARALLEL 4/0	PARALLEL 2/0	(2) 2"

- NOTES:
1. THE NEUTRAL SHALL BE INSULATED.
 2. GROUNDING CONDUCTOR FOR ALL SERVICES THRU 200 AMPS SHALL BE INSULATED #4 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.
 3. GROUNDING CONDUCTOR FOR ALL 400 AMP SERVICES SHALL BE INSULATED 1/0 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.



FLORENCE UTILITIES ELECTRICITY

SCALE NTS	APPROVED BY	DRAWN BY
DATE 01/06/22		T. PIGG
OVERHEAD SERVICE FOR HOUSE (NOT THROUGH THE ROOF)		
W.O.#		DRAWING NUMBER
		S-6095