


RESIDENTIAL SINGLE PHASE ONLY (MINIMUM SPECIFICATIONS)

SWITCH SIZE	COPPER WIRE SIZE		ALUMINUM WIRE SIZE		CONDUIT SIZE
	PHASE CONDUCTORS TYPE THW	NEUTRAL INSULATED ONLY	PHASE CONDUCTORS TYPE THW	NEUTRAL INSULATED ONLY	
200	2/0	#2	4/0	2/0	2"
400	PARALLEL 2/0	PARALLEL #2	PARALLEL 4/0	PARALLEL 2/0	(2) 2"


COMMERCIAL SINGLE PHASE ONLY (MINIMUM SPECIFICATIONS)

SWITCH SIZE	COPPER WIRE SIZE		ALUMINUM WIRE SIZE		CONDUIT SIZE
	PHASE CONDUCTORS TYPE THW	NEUTRAL INSULATED ONLY	PHASE CONDUCTORS TYPE THW	NEUTRAL INSULATED ONLY	
200	3/0	3/0	250 MCM	250 MCM	2 1/2"
400	PARALLEL 3/0	PARALLEL 3/0	PARALLEL 250 MCM	PARALLEL 250 MCM	(2) 2 1/2"

- NOTES:
1. THE NEUTRAL SHALL BE INSULATED.
 2. GROUNDING CONDUCTOR FOR ALL SERVICES THRU 200 AMPS SHALL BE #4 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.
 3. GROUNDING CONDUCTOR FOR ALL 400 AMP SERVICES SHALL BE 1/0 COPPER MINIMUM. COPPER CONDUCTORS ONLY SHALL BE USED.
 4. F.E.D. RECOMMENDS THAT CUSTOMER COMPLY WITH NATIONAL ELECTRICAL CODE (LATEST EDITION) WITH REGARD TO WIRING METHODS AND MATERIALS FOR CUSTOMER OWNED FACILITIES.

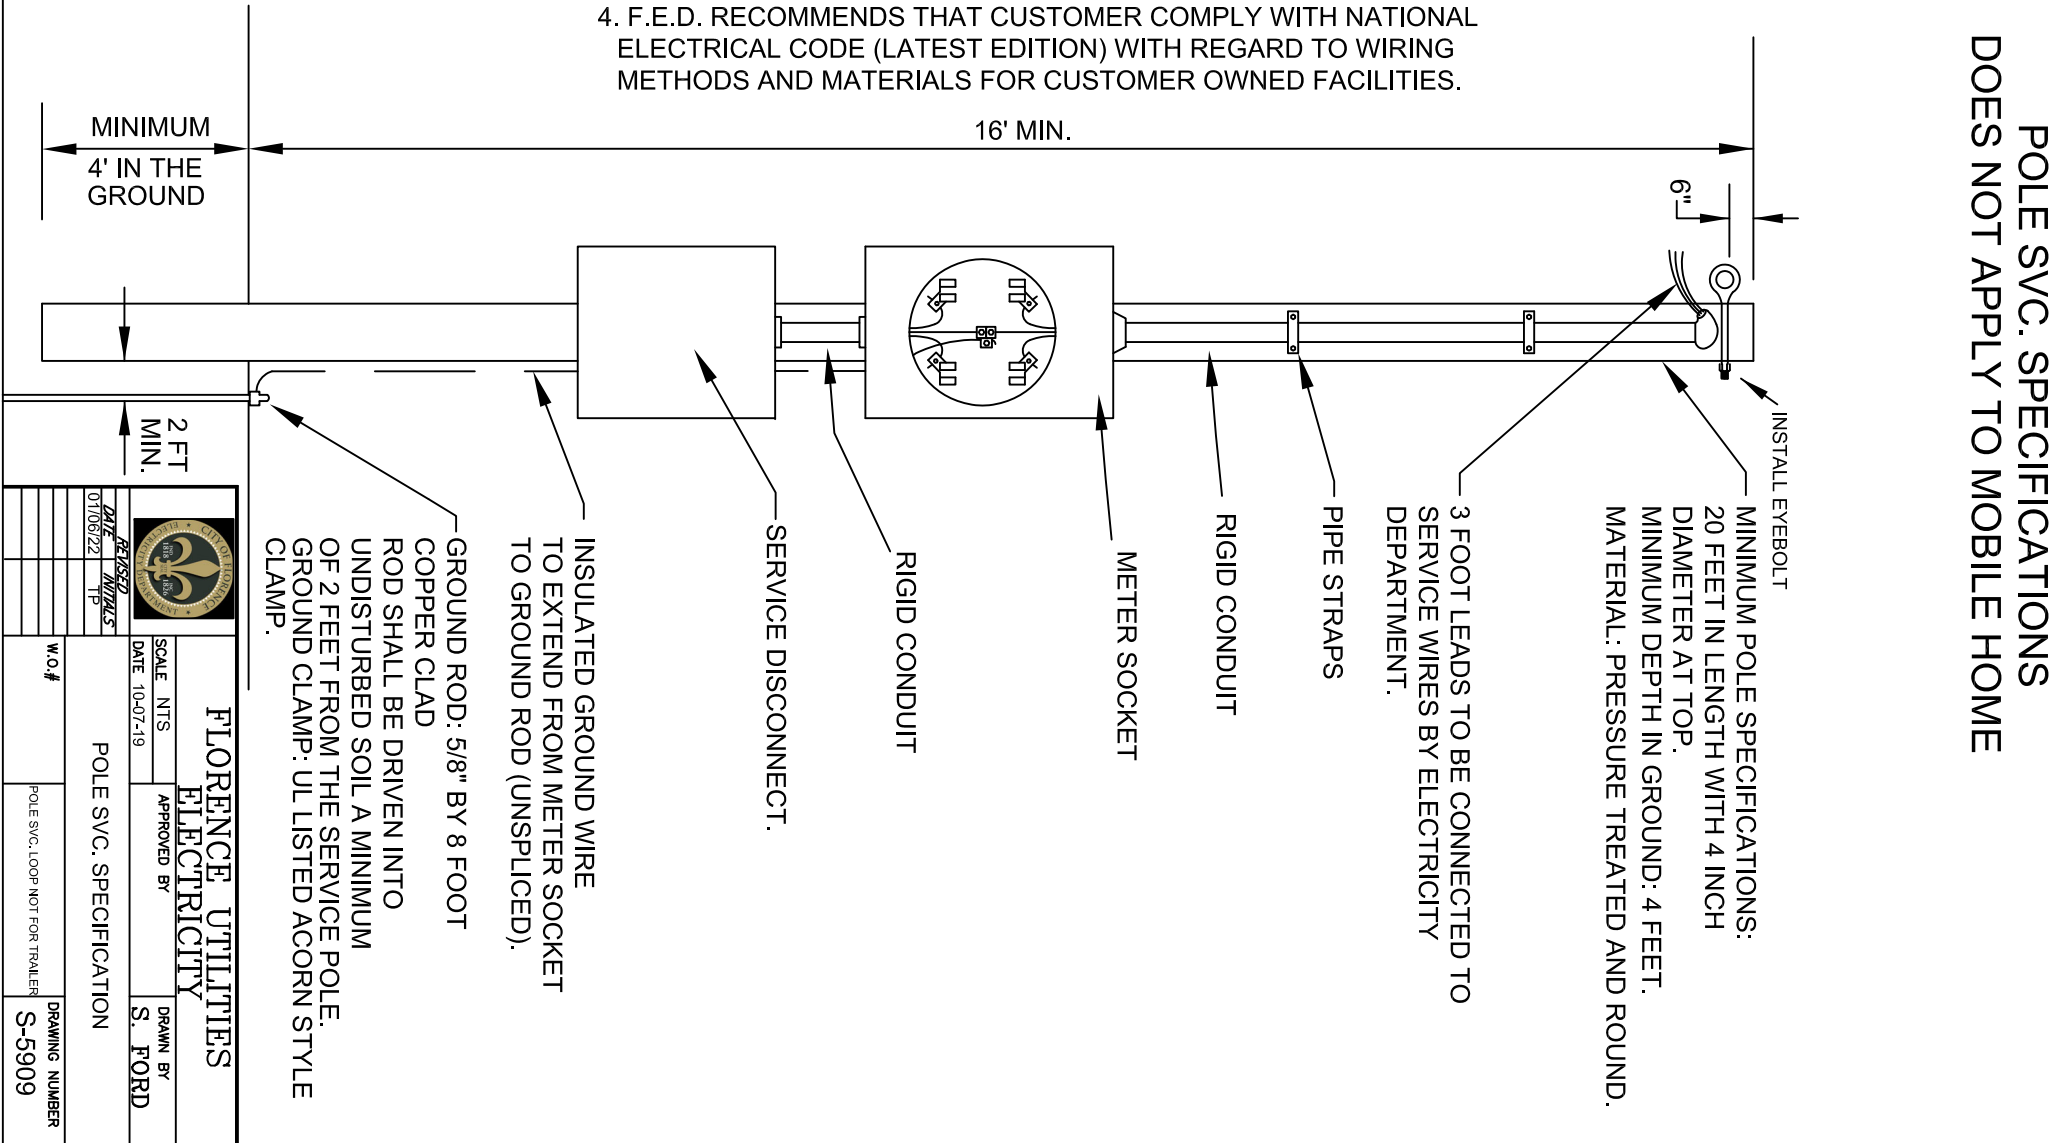

POLE SVC. SPECIFICATIONS DOES NOT APPLY TO MOBILE HOME

		FLORENCIA UTILITIES ELECTRICITY	
		SCALE NTS DATE 10-07-19	APPROVED BY S. FORD
DATE 01/06/22 RELEASED TP	POLE SVC. SPECIFICATION		DRAWING NUMBER S-5909
W.O.#	POLE SVC. LOOP NOT FOR TRAILER		DRAWING NUMBER S-5909