




WOOD POLE-UNDERGROUND POWER
N.T.S.

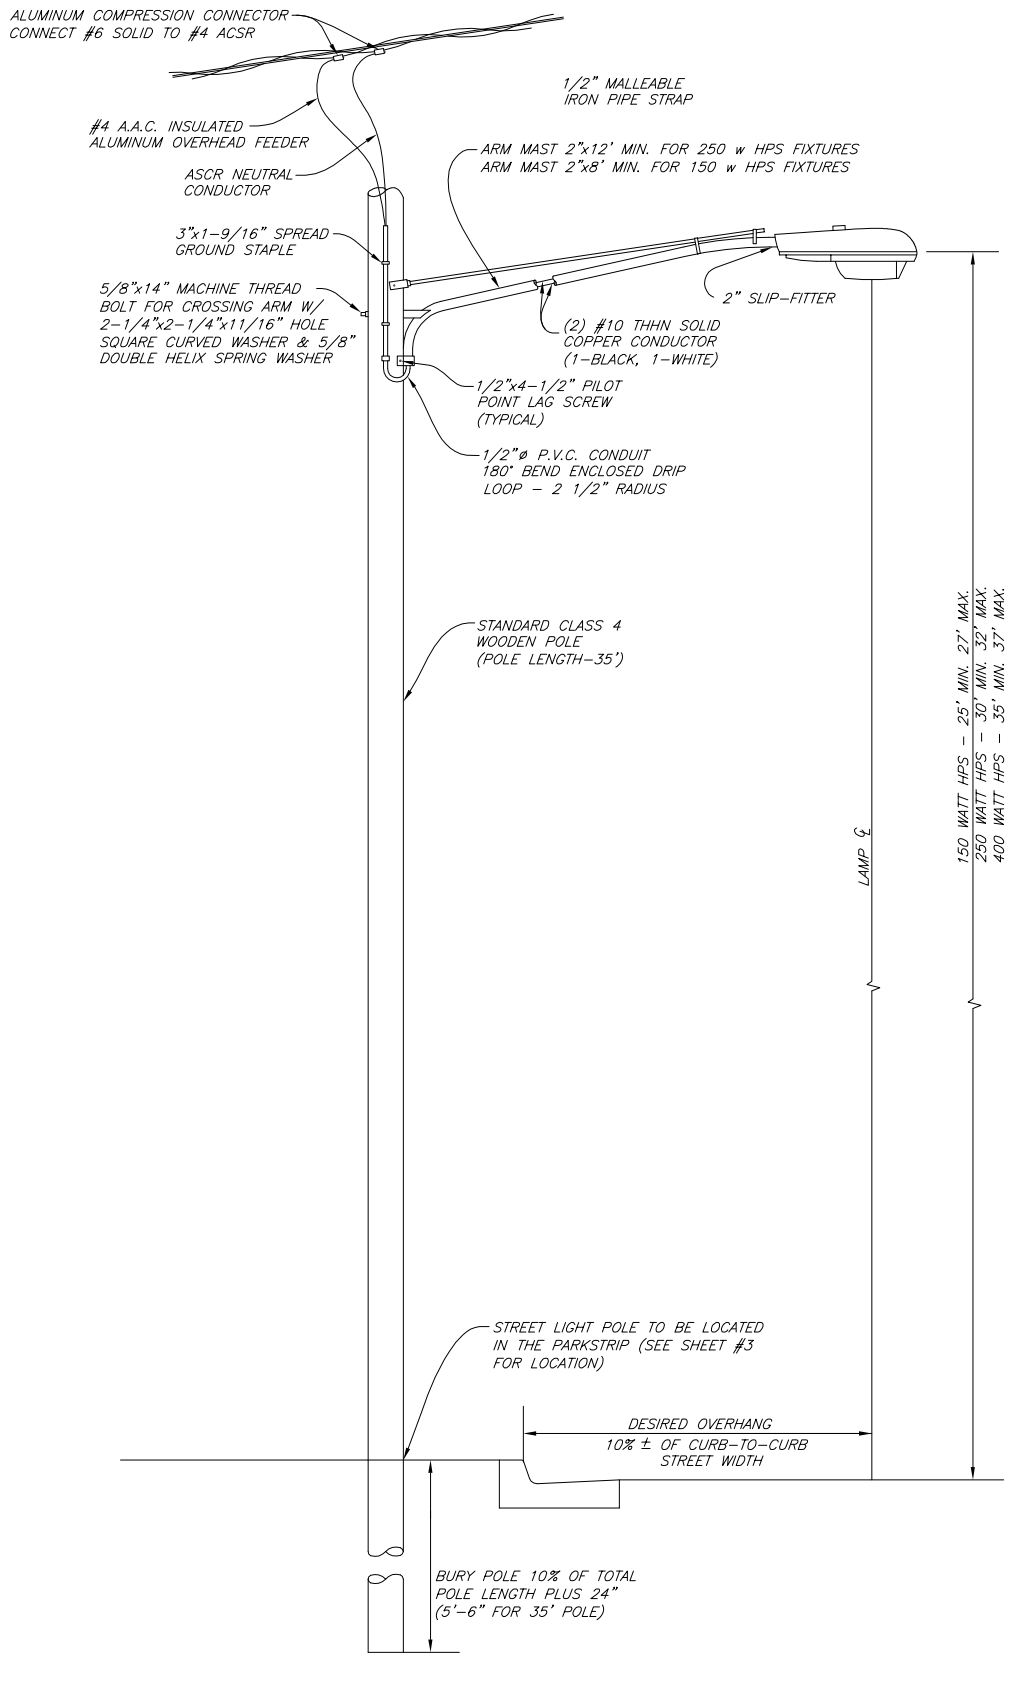


WOOD POLE-OVERHEAD POWER
N.T.S.

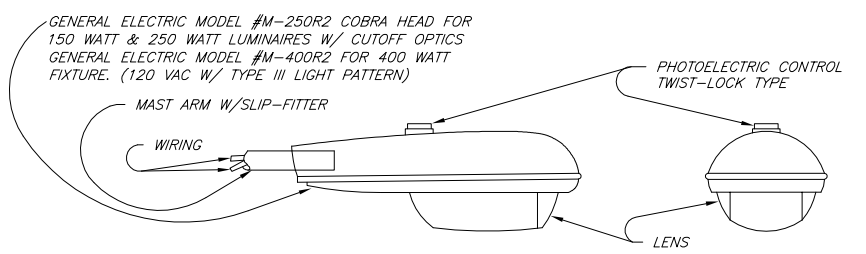

HORIZONTAL LUMINAIRE
N.T.S.

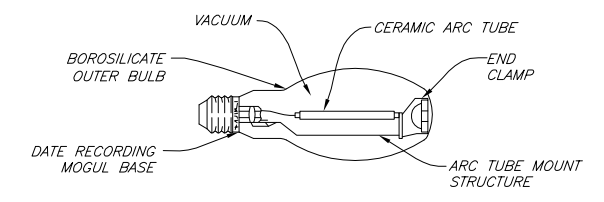

TYPICAL HPS LAMP
N.T.S.

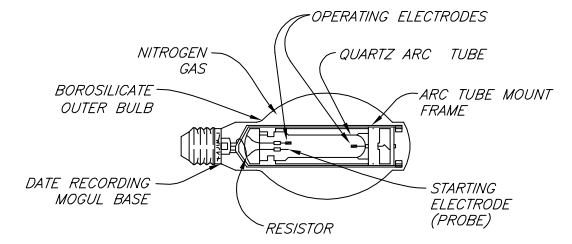


TYPICAL METAL HALIDE LAMP
(FOR MAINTENANCE REPLACEMENT ONLY)
N.T.S.

ATTENTION
DEVELOPER/CONTRACTOR SHALL NOTIFY THE UTAH POWER & LIGHT DESIGN OFFICE PRIOR TO LIGHTING INSTALLATION TO ARRANGE FOR POWER TO BE PROVIDED ON-SITE, AS WELL AS APPROVAL OF LIGHTING UNIT LOCATIONS AND APPROVAL OF ACTUAL COMPONENT SELECTION.

NOTE:
ALL CONSTRUCTION SHALL CONFORM TO PACIFICORP/UTAH POWER & LIGHT DISTRIBUTION CONSTRUCTION STANDARDS MANUAL FOR CURRENT CONSTRUCTION STANDARDS.

ALL MATERIALS AND FINISHED WORK TO BE APPROVED BY SOUTH OGDEN CITY AND THE CITY ENGINEER.

WC-CAD\07-SOC\800-CITY-STNDS\PUBLIC-WORKS\DWG\SO-STD-16.DWG



WC **WASATCH CIVIL**
Consulting Engineering
5320 SOUTH 1950 WEST, SUITE 1
ROY CITY, UT 84067 (801) 775-9191

REV.	DATE	APPR.

DESIGNED M.T.M. DATE JAN. 23, 2004
DRAWN C.C.S. SCALE: NOT TO SCALE
CHECKED M.T.M.

SOUTH OGDEN CITY CORPORATION

PUBLIC WORKS STANDARDS
STREET LIGHTING STANDARDS

SHEET:
16
OF 17 SHEETS