

FIG. 1

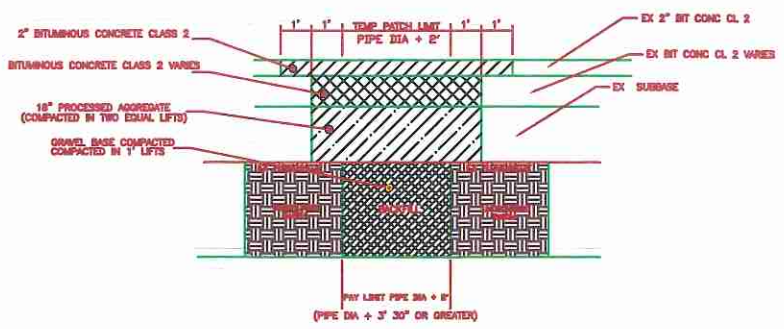


FIG. 2

STANDARD STREET  
TRENCH PATCH DETAIL

NOT TO SCALE

CONSTRUCTION SEQUENCE

- 1) CONTACT ENGINEERING DEPARTMENT (800) 845-5240 48 HRS PRIOR TO START OF CONSTRUCTION TO ARRANGE INSPECTION AND COMPACTION TESTING SERVICES
- 2) SAW CUT FULL DEPTH (6") BIT CONC PAVEMENT A MINIMUM OF ONE FOOT BEYOND LIMITS OF TEMPORARY PATCH TO NEAT, SQUARE LINES
- 3) REMOVE EXISTING MATERIAL TO A REQUIRED DEPTH AND COMPACT EXISTING SUBGRADE
- 4) PLACE PROCESSED AGGREGATE (COMPACTED IN EQUAL LIFTS)
- 5) TACK COAT VERTICAL FACE OF EXISTING CLASS BITUMINOUS CONCRETE (2" MINIMUM)
- 6) PLACE REQUIRED BITUMINOUS CONCRETE CLASS 2 (COMPACTED IN TWO EQUAL LIFTS)
- 7) SAW CUT BITUMINOUS CONCRETE PAVEMENT TO A DEPTH OF 2", A MINIMUM OF ONE FOOT BEYOND THE LIMITS OF CLASS 2 PATCH (AND OR FULL LANE WIDTH OR FULL ROADWAY WIDTH DEPENDING ON WHERE TRENCH OR PATCH IS IN ROAD.)
- 8) REMOVE EXISTING BITUMINOUS CONCRETE TO A DEPTH OF 2"
- 9) TACK COAT VERTICAL FACE AND HORIZONTAL SURFACE OF BITUMINOUS CONCRETE
- 10) PLACE 2" (MIN.) BITUMINOUS CONCRETE CLASS 2 (COMPACTED IN TWO EQUAL LIFTS)

EXCEPTIONS

- 1) REPAIRS UNDER - THROUGH DEPTH TO BE 6" MINIMUM
- 2) SUBGRADE AND - THROUGH DEPTH TO BE 6" MINIMUM

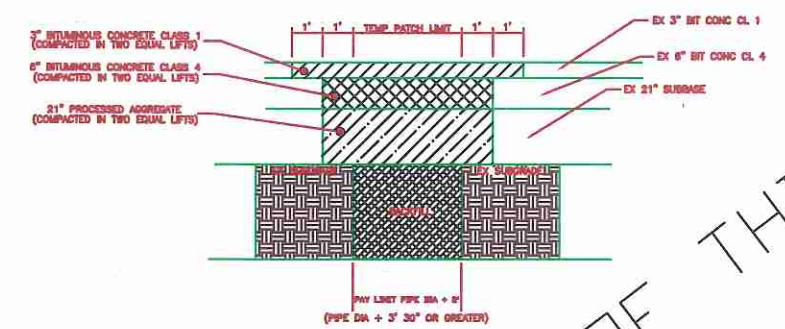


FIG. 3

FRENCH STREET  
TRENCH PATCH DETAIL

NOT TO SCALE

CONSTRUCTION SEQUENCE

- 1) CONTACT ENGINEERING DEPARTMENT (800) 845-5240 48 HRS PRIOR TO START OF CONSTRUCTION TO ARRANGE INSPECTION AND COMPACTION TESTING SERVICES
- 2) SAW CUT FULL DEPTH (6") BIT CONC PAVEMENT A MINIMUM OF ONE FOOT BEYOND LIMITS OF TEMPORARY PATCH TO NEAT, SQUARE LINES
- 3) REMOVE EXISTING MATERIAL TO A DEPTH OF 30" AND COMPACT EXISTING SUBGRADE
- 4) PLACE 21" PROCESSED AGGREGATE (COMPACTED IN TWO EQUAL LIFTS)
- 5) TACK COAT VERTICAL FACE OF EXISTING CLASS 4 BITUMINOUS CONCRETE
- 6) PLACE 6" BITUMINOUS CONCRETE CLASS 4 (COMPACTED IN TWO EQUAL LIFTS)
- 7) SAW CUT BITUMINOUS CONCRETE PAVEMENT TO A DEPTH OF 2", A MINIMUM OF ONE FOOT BEYOND THE LIMITS OF CLASS 2 PATCH (AND OR FULL LANE WIDTH OR FULL ROADWAY WIDTH DEPENDING ON WHERE TRENCH OR PATCH IS IN ROAD. SEE FIG "B-A" ABOVE)
- 8) REMOVE EXISTING BITUMINOUS CONCRETE TO A DEPTH OF 3"
- 9) TACK COAT VERTICAL FACE AND HORIZONTAL SURFACE OF BITUMINOUS CONCRETE
- 10) PLACE 3" BITUMINOUS CONCRETE CLASS 1 (COMPACTED IN TWO EQUAL LIFTS)

NO.	REVISIONS	BY	DATE	DES BY:	DATE:	<p>TOWN OF WATERTOWN DEPARTMENT OF PUBLIC WORKS DIVISION OF ENGINEERING</p>	PROJECT TITLE:	<p>TOWN OF WATERTOWN STANDARD DETAILS</p>	DRAWING TITLE:	<p>TRENCH PATCH DETAILS</p>	PROJECT NO.
				DRN BY:	DATE:				FILE NO.		
				CHK BY:	SCALE:		SUBMITTED BY:		DRAWING NO.		
				APPD BY:	DATE:		APPROVED BY:		SHEET NO.		